


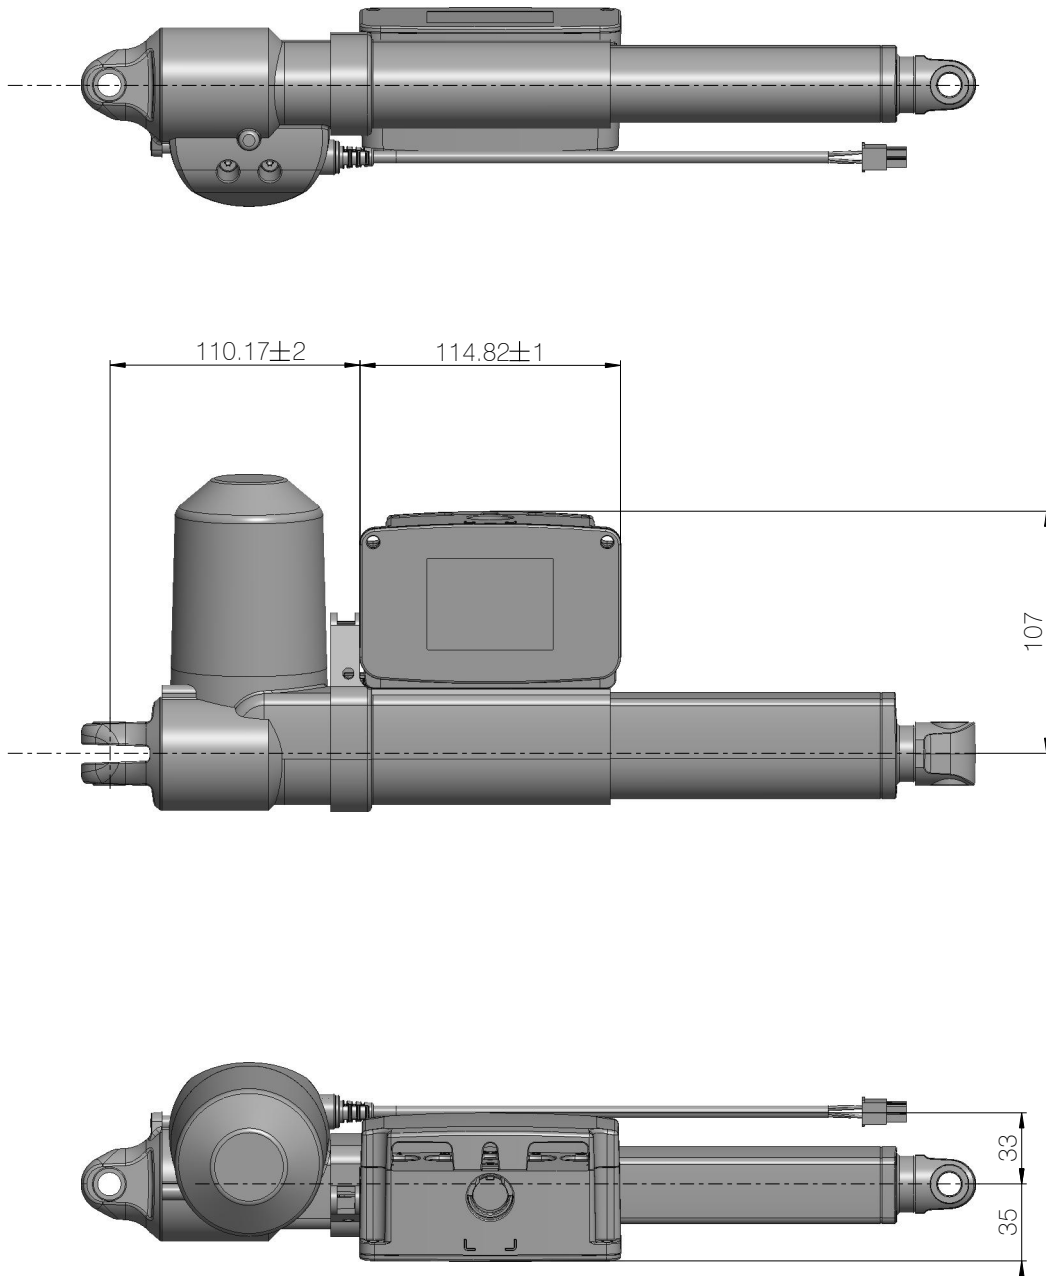

Note
Required actuator minimum BID is 255mm.

Created By	Bilon Zhang	2025-11-13
Modified By	Bilon Zhang	2025-11-13